



Hydrant Meter Application & Agreement

APPLICANT'S INFORMATION

ACCOUNT NUMBER: _____ METER NUMBER: _____

NAME _____ COMPANY _____

BILLING ADDRESS _____

CITY _____ STATE _____ ZIP CODE _____

PHONE NUMBER _____ DL# _____ DL State _____ FED TAX ID _____

SERVICE LOCATION

SERVICE ADDRESS _____ CITY _____

TODAY'S DATE _____ REQUESTED SERVICE COMMENCEMENT DATE (allow 3 days for install) _____


REQUIREMENTS OF USE

Please initial to acknowledge understanding of the following requirements:

- _____ • A \$1000.00 deposit & application fee, pre-paid in advance, is required for hydrant meter service.
- _____ • A backflow prevention device must be installed on all hydrant meters before water is consumed.
- _____ • Customer will be responsible for backflow assembly.
- _____ • Authorized water consumption will not be granted until the backflow device has been successfully tested by a certified San Bernardino County backflow tester and the passing results submitted to the District. (To obtain a listing of certified testers, please contact the San Bernardino Safe Drinking Water Division at (909) 387-4666).
- _____ • No part of the installation shall protrude into traffic or pose a safety hazard to pedestrians or vehicles. If necessary, safety warning devices must be in place.
- _____ • Use only a hydrant meter wrench to operate the hydrant.
- _____ • When using the service, slowly open and close the hydrant to prevent water hammer.
- _____ • Meter is subject to removal if bill payment is not received by indicated due date, and will be subject to a Reconnect Fee.
- _____ • Applicant will be charged for meter repairs or a replacement meter in the event the meter is damaged, lost or stolen.
- _____ • Drawing water from a District hydrant without the use of a meter, unauthorized removal of the meter, or tampering with the meter or locking device will result in a forfeiture of the deposit.
- _____ • Only District staff is authorized to move hydrant meters. If relocation is required, the applicant must notify the District 24 hours in advance and pay the hydrant meter relocation fee.

The undersigned applicant accepts responsibility for payment of all charges for water services provided by the Monte Vista Water District and agrees to comply with all District regulations governing such services as outlined in the District's Administrative Code. The District reserves the right to terminate this agreement without warning.

SIGNATURE _____ DATE _____

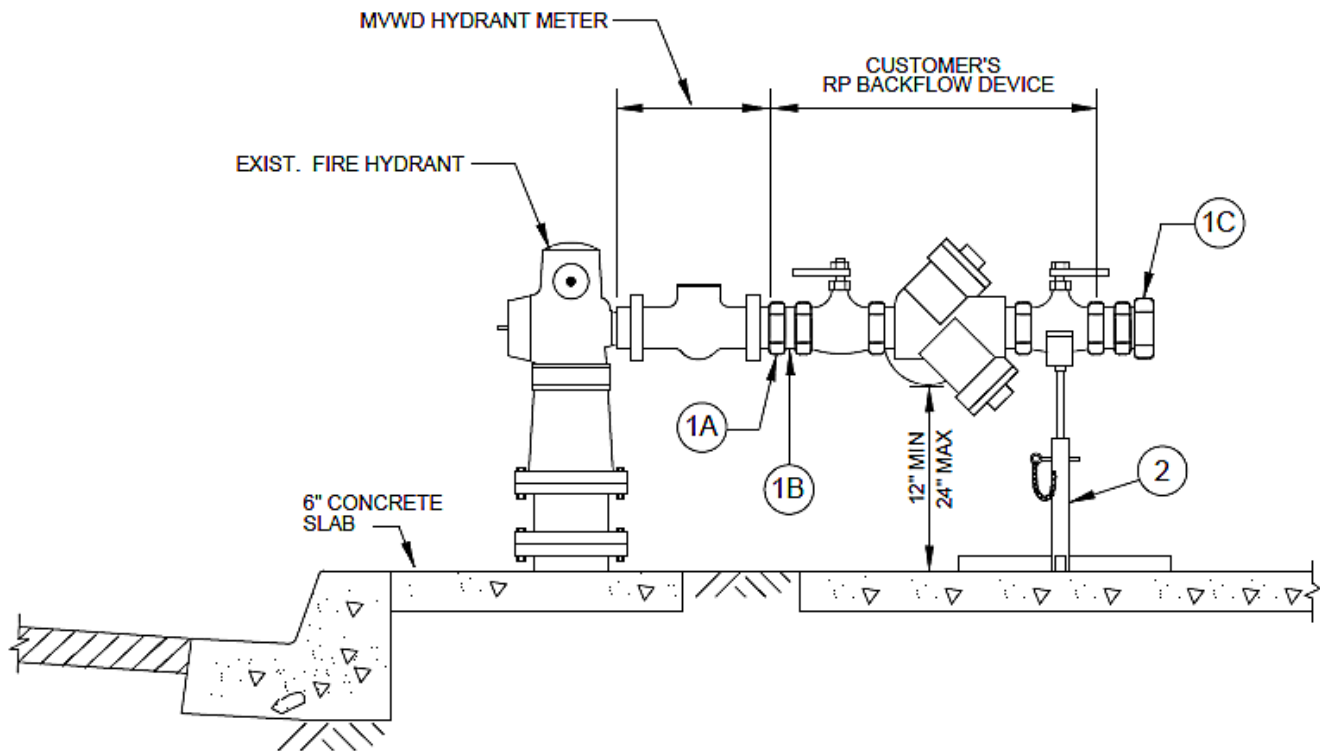

NOTES:

1. PARTS NEEDED:
 - 1A. FEMALE 2 1/2" NST "SWIVEL TYPE ADAPTER" (NATIONAL SANITARY THREAD) X MALE 2" IPT FOR CONNECTING RP TO HYDRANT METER.
 - 1B. 2" CLOSE NIPPLE.
 - 1C. 2" FEMALE IPT X 2 1/2" MALE NST FOR CONNECTING STANDARD FIRE HOSE TO BACKFLOW PREVENTION DEVICE. THE DEVICE AND FITTINGS ARE AVAILABLE AT MANY PLUMBING SUPPLY BUSINESSES.
2. A SUPPORT FOR THE BACKFLOW PREVENTION DEVICE MUST INSTALLED USING ANY SUITABLE MATERIAL.
3. NO PART OF THE INSTALLATION SHOULD PROTRUDE INTO TRAFFIC OR POSE A SAFETY HAZARD TO PEDESTRIANS OR VEHICLES. IF NECESSARY, PLACE SAFETY WARNING DEVICES.
4. USE A HYDRANT METER WRENCH TO OPERATE THE HYDRANT. WHEN USING THE SERVICE, SLOWLY OPEN AND CLOSE THE HYDRANT TO PREVENT WATER HAMMER.
5. SLOWLY OPEN AND CLOSE VALVES ON EITHER END OF BACKFLOW PREVENTION DEVICE TO PREVENT WATER HAMMER, INCLUDING VALVE AT END OF HOSE.
6. REMOVE HOSE FROM DEVICE AT END OF EACH DAY'S USE.